


**NOTES:**

1. ALL JOINTS FOR HYDRANT INSTALLATION SHALL BE MEGA LUG.
2. HYDRANT LATERALS SHALL BE CONSTRUCTED FROM ONE CONTINUOUS PIPE LINK. HYDRANT LATERALS WITH BELL JOINTS AND COUPLINGS WILL NOT BE ACCEPTED.
3. CONSTRUCT A HYDRANT DRAINING SUMP TO EITHER SIDE OF THE HYDRANT. PROVIDE DRAIN CONNECTION TO SUMP.



**ELEVATION**

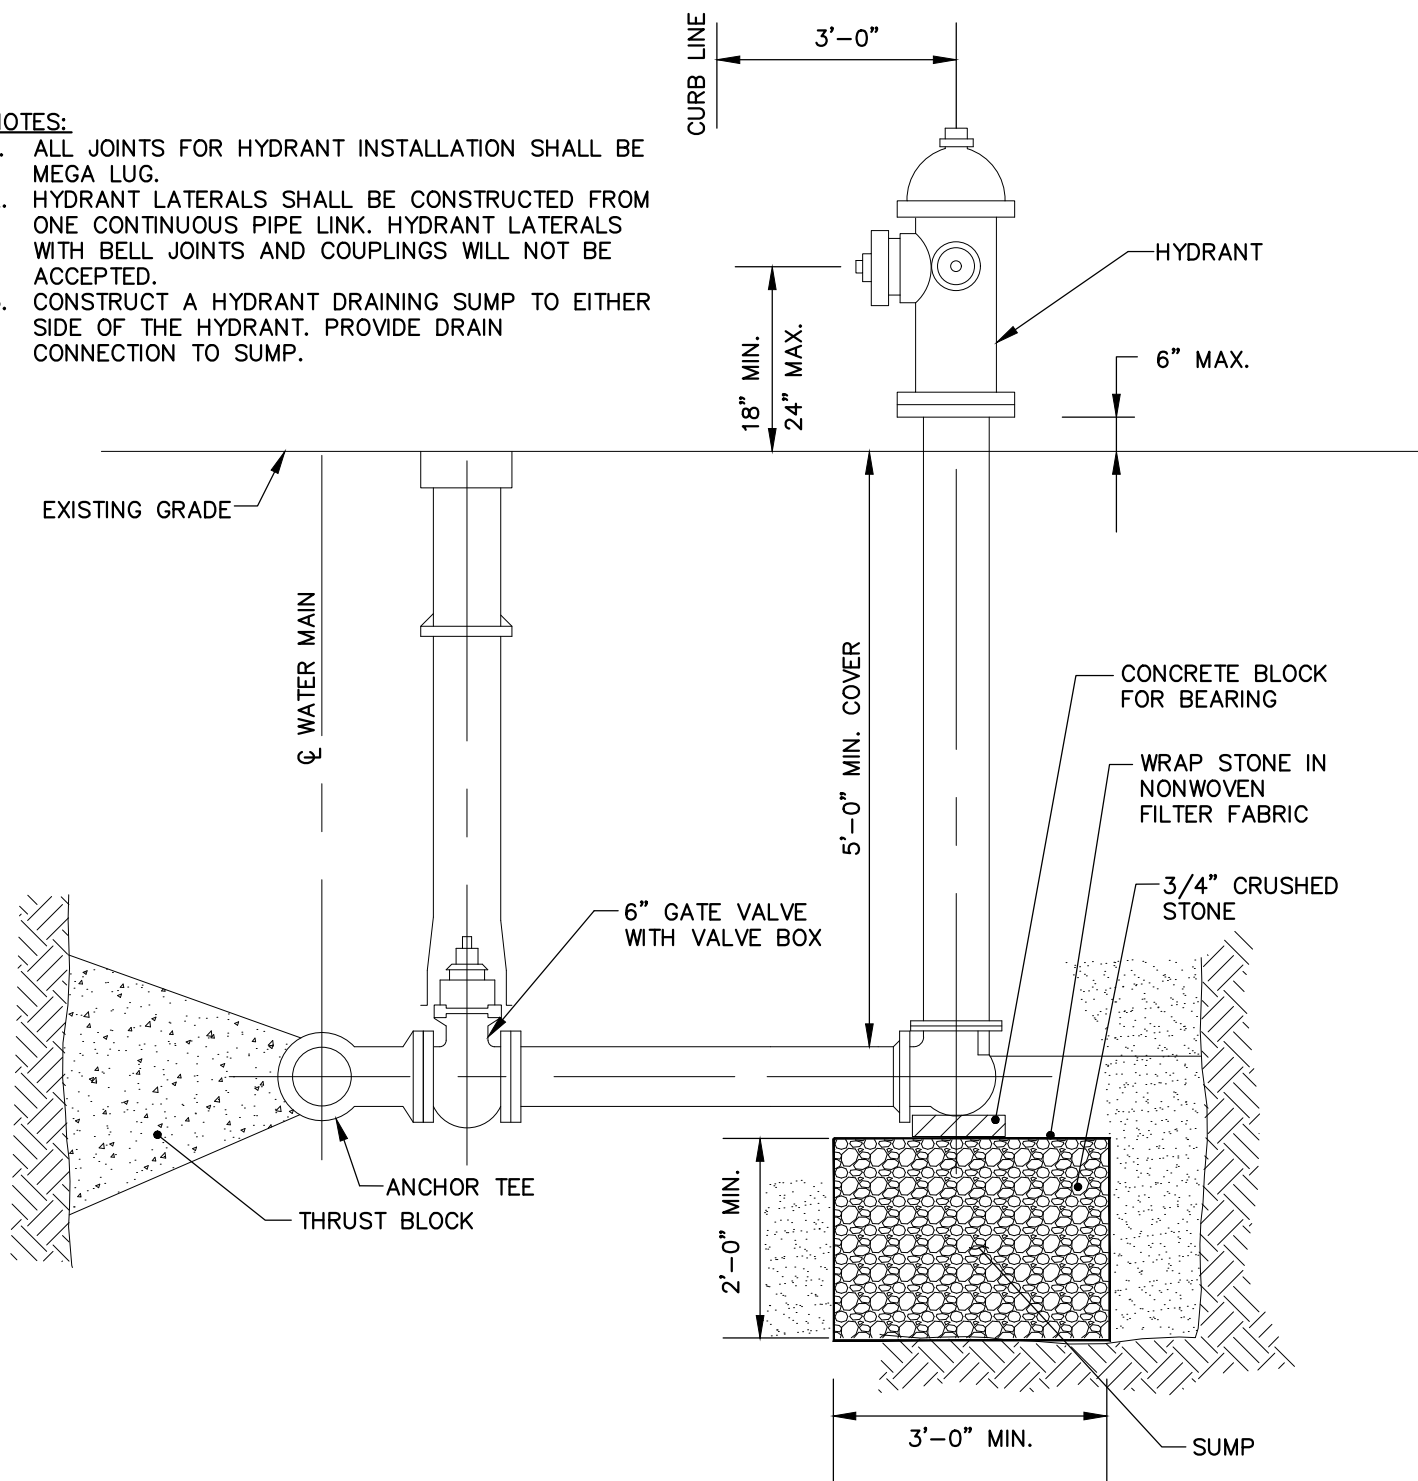

**DEPARTMENT OF PUBLIC WORKS  
ENGINEERING DIVISION  
TOWN OF BILLERICA,  
MASSACHUSETTS**

**HYDRANT**

CREATED BY: DCW/KCS

SCALE: NTS

FILE:

CHECKED BY: GA/JT

DATE: 06/29/2015