


**SECTION**

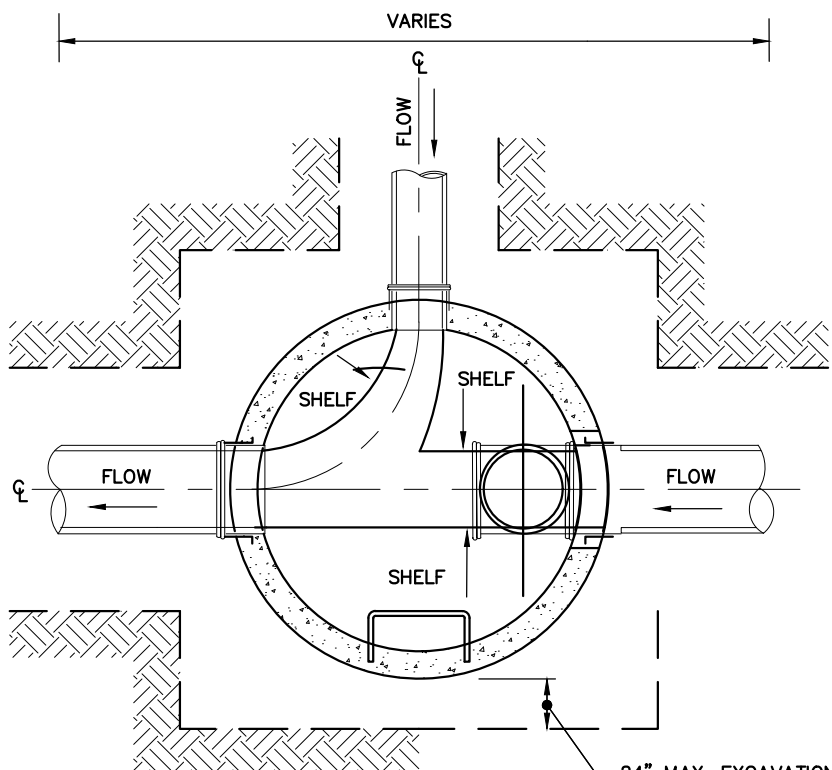

**PLAN**

24" MAX. EXCAVATION  
PAY LIMIT (TYP.)

**NOTES:**

1. SEE PRECAST SEWER/DRAIN MANHOLE FOR TYPICAL MANHOLE INFORMATION.
2. INTERIOR DROP SHALL BE PROVIDED WHEREVER THE CONNECTION TO THE MANHOLE IS MORE THAN 2.0' ABOVE THE INVERT.
3. CUT OFF TOP 1/3 OF PIPE PLUG.
4. UNLESS OTHERWISE NOTED, USE MIN. 2.0' PIPE STUB FROM OUTSIDE FACE OF MANHOLE WITH WATERTIGHT CAP FOR PVC PIPE. USE MIN. 4.0' PIPE STUB FROM OUTSIDE FACE OF MANHOLE AND WATER TIGHT CAP FOR DI PIPE. MINIMUM SLOPE OF ALL STUBS SHALL BE 0.02 FEET/FOOT.
5. OUTSIDE DROPS ARE NOT PERMITTED.



**DEPARTMENT OF PUBLIC WORKS  
ENGINEERING DIVISION  
TOWN OF BILLERICA,  
MASSACHUSETTS**

## PRECAST MANHOLE WITH INSIDE DROP

CREATED BY: DCW/KCS

SCALE: NTS

FILE:

CHECKED BY: GA/JT

DATE: 06/29/2015