

ANNUAL WATER QUALITY REPORT

Reporting Year 2025



Presented By
Billerica Water Division

PWS ID#: 3031000



Our Commitment

We are pleased to present to you this year's annual water quality report. This report is a snapshot of last year's water quality covering all testing performed between January 1 and December 31, 2025. Included are details about your source of water, what it contains, and how it compares to standards set by regulatory agencies. Our constant goal is to provide you with a safe and dependable supply of drinking water. We want you to understand the efforts we make to continually improve the water treatment process and protect our water resources. We are committed to ensuring the quality of your water and providing you with this information because informed customers are our best allies.

Where Does Our Drinking Water Come From?

Town of Billerica Water Division customers are fortunate because we enjoy an abundant water supply from the Concord River. The Concord River begins at its namesake, within the Town of Concord, by the joining of the Sudbury and Assabet Rivers. The Concord River flows through Bedford and enters Billerica through Carlisle. The watershed above our point of intake is about 400 square miles and lies in all or part of 36 towns and cities in Massachusetts.

The water treatment plant, located off Treble Cove Road, has been servicing the town since replacing the previous treatment plant on Boston Road in 2006, providing an average of 1.6 billion gallons of clean drinking water each year between 2020 and 2025.

The Benefits of Fluoridation

Fluoride is naturally occurring in many water supplies in trace amounts. In our system, the fluoride level is adjusted to an optimal level averaging 0.7 part per million (ppm) to improve oral health and prevent tooth decay. At this level, it is safe, odorless, colorless, and tasteless. There are over 4 million people in Massachusetts water systems and 184 million people in the U.S. who receive the health and economic benefits of fluoridation.



Important Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health-care providers. U.S. Environmental Protection Agency (U.S. EPA)/Centers for Disease Control and Prevention (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available by emailing the U.S. EPA at safewater@epa.gov.



Water Main Flushing

Distribution mains (pipes) convey water to homes, businesses, and hydrants in your neighborhood. The water entering distribution mains is of very high quality; however, water quality can deteriorate in areas of the distribution mains over time. Water main flushing is the process of cleaning the interior of water distribution mains by sending a rapid flow of water through them.

Flushing maintains water quality in several ways. For example, flushing removes sediments like iron and manganese. Although iron and manganese do not pose health concerns, they can affect the taste, clarity, and color of the water. Additionally, sediments can shield microorganisms from the disinfecting power of chlorine, contributing to the growth of microorganisms within distribution mains. Flushing helps remove stale water and ensures the presence of fresh water with sufficient dissolved oxygen and disinfectant levels and an acceptable taste and smell.

During flushing operations in your neighborhood, some short-term deterioration of water quality, though uncommon, is possible. You should avoid tap water for household uses at that time. If you do use the tap, allow your cold water to run for a few minutes at full velocity before use, and avoid using hot water to prevent sediment accumulation in your hot water tank.

Please contact us if you have any questions or if you would like more information on our water main flushing schedule.

QUESTIONS?

For more information about this report, or for any questions relating to your drinking water, please call Jason Hamm, Billerica Water Division - Compliance Manager, at (978) 671-0957.



Substances That Could Be in Water

To ensure that tap water is safe to drink, the U.S. EPA and the Massachusetts Department of Environmental Protection (DEP) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) and Massachusetts Department of Public Health regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material and can pick up substances resulting from the presence of animals or from human activity. Substances that may be present in source water include:

Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife;

Inorganic Contaminants, such as salts and metals, which can be naturally occurring or may result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses;


Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production and which may also come from gas stations, urban stormwater runoff, and septic systems; and

Radioactive Contaminants, which can be naturally occurring or the result of oil and gas production and mining activities.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.

Lead in Home Plumbing

Lead can cause serious health effects in people of all ages, especially pregnant people, infants (both formula-fed and breastfed), and young children. Lead in drinking water is primarily from materials and parts used in service lines and home plumbing. Billerica Water Division is responsible for providing high-quality drinking water and removing lead pipes but cannot control the variety of materials used in the plumbing in your home. Because lead levels may vary over time, lead exposure is possible even when your tap sampling results do not detect lead at one point in time. You can help protect yourself and your family by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Using a filter certified by an American National Standards Institute-accredited certifier to reduce lead is effective in reducing lead exposures. Follow the instructions provided with the filter to ensure it is used properly. Use only cold water for drinking, cooking, and making baby formula. Boiling does not remove lead from water.

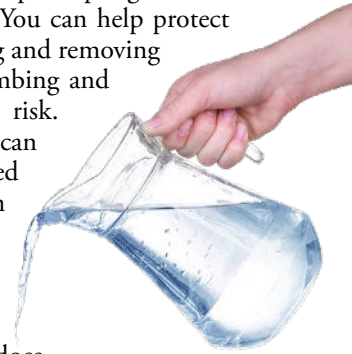

Before using tap water for drinking, cooking, or making baby formula, flush your pipes for several minutes. You can do this by running your tap, taking a shower, or doing laundry or a load of dishes. If you have a lead service line or galvanized requiring replacement service line, you may need to flush your pipes for a longer period. If you are concerned about lead in your water and wish to have it tested, contact Billerica Water Division at (978) 671-0957. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at epa.gov/safewater/lead.

To address lead in drinking water, public water systems were required to develop and maintain an inventory of service line materials by October 16, 2024. Developing an inventory and identifying the location of lead service lines (LSL) is the first step for beginning LSL replacement and protecting public health. We developed a service line inventory, and it may be viewed in person at the water treatment plant located at 270 Treble Cove Road. Please contact us if you would like more information about the inventory or any lead sampling that has been done.

Community Water Fluoridation

The safety and benefits of fluoride are well documented. For over 70 years, U.S. citizens have benefited from drinking water containing fluoride, leading to better dental health. Drinking fluoridated water keeps teeth strong and has reduced tooth decay by approximately 25 percent in children and adults.

Over the past several decades, there have been major improvements in oral health. Still, tooth decay remains one of the most common chronic diseases of childhood. Community water fluoridation has been identified as the most cost-effective method of delivering fluoride to all members of the community, regardless of age, educational attainment, or income level.

Nearly all water contains some fluoride, but usually not enough to help prevent tooth decay or cavities. Public water systems can add the right amount of fluoride to the local drinking water to prevent tooth decay.

Community water fluoridation is recommended by nearly all public health, medical, and dental organizations in the U.S. Because of its contribution to the dramatic decline in tooth decay, the CDC named community water fluoridation one of the greatest public health achievements of the 20th century (cdc.gov/fluoridation).

Source Water Assessment

A source water assessment has been completed for our system. The purpose of the assessment is to determine the susceptibility of each drinking water source to potential contaminant sources. The report includes background information and a relative susceptibility rating of higher, moderate, or lower. It is important to understand that a higher susceptibility rating does not imply poor water quality, only the system's potential to become contaminated within the assessment area. The assessment findings are summarized in the table below.

| SUSCEPTIBILITY TO POTENTIAL CONTAMINANT SOURCES | | |
|---|-------------|-----------------------|
| SOURCE NAME | SOURCE ID | SUSCEPTIBILITY RATING |
| Concord River | 3031000-01S | High |

If you would like a copy of our assessment, it is available at mass.gov/doc/northeast-region-source-water-assessment-protection-swap-program-reports/download.

What's a Cross-Connection?

Cross-connections that contaminate drinking water distribution lines are a major concern. A cross-connection is formed at any point where a drinking water line connects to equipment (boilers), systems containing chemicals (air-conditioning systems, fire sprinkler systems, irrigation systems), or water sources of questionable quality. Cross-connection contamination can occur when the pressure in the equipment or system is greater than the pressure inside the drinking water line (backpressure). Contamination can also occur when the pressure in the drinking water line drops due to fairly routine occurrences (main breaks, heavy water demand), causing contaminants to be sucked out from the equipment and into the drinking water line (backsiphonage).

Outside water taps and garden hoses tend to be the most common sources of cross-connection contamination at home. The garden hose creates a hazard when submerged in a swimming pool or attached to a chemical sprayer for weed killing. Garden hoses that are left lying on the ground may be contaminated by fertilizers, cesspools, or garden chemicals. Improperly installed valves in your toilet could also be a source of cross-connection contamination.

Community water supplies are continuously jeopardized by cross-connections unless appropriate valves, known as backflow prevention devices, are installed and maintained. We have surveyed industrial, commercial, and institutional facilities in the service area to make sure that potential cross-connections are identified and eliminated or protected by a backflow preventer. We also inspect and test backflow preventers to make sure that they provide maximum protection.

For more information on backflow prevention, contact the Safe Drinking Water Hotline at (800) 426-4791.

What Are PFAS?

Per- and polyfluoroalkyl substances (PFAS) are a group of manufactured chemicals used worldwide since the 1950s to make fluoropolymer coatings and products that resist heat, oil, stains, grease, and water. During production and use, PFAS can migrate into the soil, water, and air. Most PFAS do not break down; they remain in the environment, ultimately finding their way into drinking water. Because of their widespread use and their persistence in the environment, PFAS are found all over the world at low levels. Some PFAS can build up in people and animals with repeated exposure over time.



The most commonly studied PFAS are perfluorooctanoic acid (PFOA) and perfluorooctanesulfonic acid (PFOS). PFOA and PFOS have been phased out of production and use in the United States, but other countries may still manufacture and use them.

Some products that may contain PFAS include:

- Some grease-resistant paper, fast food containers/wrappers, microwave popcorn bags, pizza boxes
- Nonstick cookware
- Stain-resistant coatings used on carpets, upholstery, and other fabrics
- Water-resistant clothing
- Personal care products (shampoo, dental floss) and cosmetics (nail polish, eye makeup)
- Cleaning products
- Paints, varnishes, and sealants

Even though recent efforts to remove PFAS have reduced the likelihood of exposure, some products may still contain them. If you have questions or concerns about products you use in your home, contact the Consumer Product Safety Commission at (800) 638-2772. For a more detailed discussion on PFAS, please visit bit.ly/3Z5AMm8.



Test Results

Our water is monitored for many different kinds of substances on a very strict sampling schedule, and the water we deliver must meet specific health standards. Here, we only show those substances that were detected in our water (a complete list of all our analytical results is available upon request). Remember that detecting a substance does not mean the water is unsafe to drink; our goal is to keep all detects below their respective maximum allowed levels.

The state recommends monitoring for certain substances less than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data is included, along with the year in which the sample was taken.

We participated in the fifth stage of the U.S. EPA's Unregulated Contaminant Monitoring Rule (UCMR5) program by performing additional tests on our drinking water. UCMR5 sampling benefits the environment and public health by providing the U.S. EPA with data on the occurrence of contaminants suspected to be in drinking water to determine if it needs to introduce new regulatory standards to improve drinking water quality. Unregulated contaminant monitoring data is available to the public, so please feel free to contact us if you are interested in obtaining that information. If you would like more information on the U.S. EPA's Unregulated Contaminant Monitoring Rule, please call the Safe Drinking Water Hotline at (800) 426-4791.

REGULATED SUBSTANCES

| SUBSTANCE (UNIT OF MEASURE) | YEAR SAMPLED | MCL [MRDL] | MCLG [MRDLG] | AMOUNT DETECTED | RANGE LOW-HIGH | VIOLATION | TYPICAL SOURCE |
|--|-----------------|------------------------------------|-----------------|--------------------|-------------------|-----------|---|
| Barium (ppm) | 2025 | 2 | 2 | 0.015 | NA | No | Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits |
| Bromate (ppb) | 2025 | 10 | 0 | 6.4 | ND–6.4 | No | By-product of drinking water disinfection |
| Chloramines (ppm) | 2025 | [4] | [4] | 2.20 | 1.19–2.20 | No | Water additive used to control microbes |
| Fluoride (ppm) | 2025 | 4 ¹ | 4 | 0.8 | 0.5–0.8 | No | Water additive that promotes strong teeth |
| Haloacetic Acids [HAA5] (ppb) | 2025 | 60 | NA | 25 | 10–25 | No | By-product of drinking water disinfection |
| Mercury [inorganic] (ppb) | 2025 | 2 | 2 | 0.4 | NA | No | Erosion of natural deposits; Discharge from refineries and factories; Runoff from landfills; Runoff from cropland |
| Nitrate (ppm) | 2025 | 10 | 10 | 0.26 | 0.15–0.26 | No | Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits |
| Perchlorate (ppb) | 2025 | 2 | NA | 0.25 | NA | No | Inorganic chemicals used as oxidizers in solid propellants for rockets, missiles, fireworks, and explosives |
| PFAS6 (ppt) | 2025 | 20 | NA | 12.1 | 2.65–12.1 | No | Discharges and emissions from industrial and manufacturing sources associated with the production or use of these PFAS, including production of moisture- and oil-resistant coatings on fabrics and other materials; Use and disposal of products containing these PFAS, such as firefighting foams |
| Total Organic Carbon [TOC] (percent removal) | 2025 | TT ² | NA | 76 | 46–76 | No | Naturally present in the environment |
| Total Trihalomethanes [TTHMs] (ppb) | 2025 | 80 | NA | 48 | 23–48 | No | By-product of drinking water disinfection |
| Turbidity³ (NTU) | 2025 | TT | NA | 0.29 | NA | No | Soil runoff |
| Turbidity (lowest monthly percent of samples meeting limit) | 2025 | TT = 95% of samples meet the limit | NA | 100 | NA | No | Soil runoff |

Tap water samples were collected for lead and copper analyses from sample sites throughout the community

| SUBSTANCE (UNIT OF MEASURE) | YEAR SAMPLED | AL | MCLG | AMOUNT DETECTED (90TH %ILE) | RANGE LOW-HIGH | SITES ABOVE AL/TOTAL SITES | VIOLATION | TYPICAL SOURCE |
|--------------------------------|-----------------|-----|------|-----------------------------------|-------------------|----------------------------------|-----------|---|
| Copper (ppm) | 2025 | 1.3 | 1.3 | 0.0289 | 0.0051–0.0331 | 0/30 | No | Corrosion of household plumbing systems; Erosion of natural deposits |
| Lead (ppb) | 2025 | 15 | 0 | 2.4 | ND–7.5 | 0/30 | No | Lead service lines; Corrosion of household plumbing systems, including fittings and fixtures; Erosion of natural deposits |

SECONDARY SUBSTANCES

| SUBSTANCE (UNIT OF MEASURE) | YEAR SAMPLED | SMCL | MCLG | AMOUNT DETECTED | RANGE LOW-HIGH | VIOLATION | TYPICAL SOURCE |
|------------------------------------|-----------------|---------|------|--------------------|-------------------|-----------|---|
| Aluminum (ppb) | 2025 | 200 | NA | 39 | ND–39 | No | Erosion of natural deposits; Residual from some surface water treatment processes |
| Chloride (ppm) | 2025 | 250 | NA | 185 | 102–185 | No | Runoff/leaching from natural deposits |
| Manganese (ppb) | 2025 | 50 | NA | 35 | 5–35 | No | Leaching from natural deposits |
| pH (units) | 2025 | 6.5–8.5 | NA | 9.1 | 8.6–9.1 | No | Naturally occurring; Artificially increased with addition of sodium hydroxide for corrosion control |
| Sulfate (ppm) | 2025 | 250 | NA | 53.3 | 46.9–53.3 | No | Runoff/leaching from natural deposits; Industrial wastes |
| Total Dissolved Solids [TDS] (ppm) | 2025 | 500 | NA | 420 | 308–420 | No | Runoff/leaching from natural deposits |

UNREGULATED SUBSTANCES⁴

| SUBSTANCE (UNIT OF MEASURE) | YEAR SAMPLED | AMOUNT DETECTED | RANGE LOW-HIGH | TYPICAL SOURCE |
|---|-----------------|--------------------|-------------------|-------------------|
| Bromodichloromethane (ppb) | 2025 | 15.1 | 4.9–15.1 | NA |
| Bromoform (ppb) | 2025 | 1.2 | ND–1.2 | NA |
| Chlorate (ppb) | 2025 | 510 | 240–510 | NA |
| Chlorodibromomethane (ppb) | 2025 | 8.8 | 6.5–8.8 | NA |
| Chloroform (ppb) | 2025 | 18.2 | 2.2–18.2 | NA |
| Perfluorobutanesulfonic Acid [PFBS] (ppt) | 2025 | 3.1 | ND–3.1 | NA |
| Perfluorobutanoic Acid [PFBA] (ppt) | 2025 | 5.5 | ND–5.5 | NA |
| Perfluorohexanoic Acid [PFHxA] (ppt) | 2025 | 6.1 | ND–6.1 | NA |
| Perfluorooctanoic Acid [PFOA] (ppt) | 2025 | 5.5 | ND–5.5 | NA |
| Perfluoropentanoic Acid [PFPeA] (ppt) | 2025 | 8 | ND–8 | NA |
| Sodium (ppm) | 2025 | 124 | 87–124 | NA |

¹ Fluoride has an SMCL of 2.0 ppm.

² The value reported under Amount Detected for TOC is the lowest ratio of percentage of TOC actually removed to the percentage of TOC required to be removed. A value of greater than 1 indicates that the water system is in compliance with TOC removal requirements. A value of less than 1 indicates a violation of the TOC removal requirements.

³ Turbidity is a measure of the cloudiness of the water. It is monitored because it is a good indicator of the effectiveness of the filtration system.

⁴ Unregulated contaminants are those for which the U.S. EPA has not established drinking water standards. The purpose of unregulated contaminant monitoring is to assist the U.S. EPA in determining their occurrence in drinking water and whether future regulation is warranted.

Definitions

90th %ile: Out of every 10 homes sampled, 9 were at or below this level. This number is compared to the Action Level to determine lead and copper compliance.

AL (Action Level): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Herbicide: Any chemical(s) used to control undesirable vegetation.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable.

ND (Not detected): Indicates that the substance was not found by laboratory analysis.

NTU (Nephelometric Turbidity Units): Measurement of the clarity, or turbidity, of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

Pesticide: Generally, any substance or mixture of substances intended for preventing, destroying, repelling, or mitigating any pest.

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).

ppt (parts per trillion): One part substance per trillion parts water (or nanograms per liter).

SMCL (Secondary Maximum Contaminant Level): These standards are developed to protect aesthetic qualities of drinking water and are not health based.

TT (Treatment Technique): A required process intended to reduce the level of a contaminant in drinking water.

